WHITE RIVER TOWNSHIP
FIRE DEPARTMENT
FIRE HYDRANT
INSTALLATION DETAIL

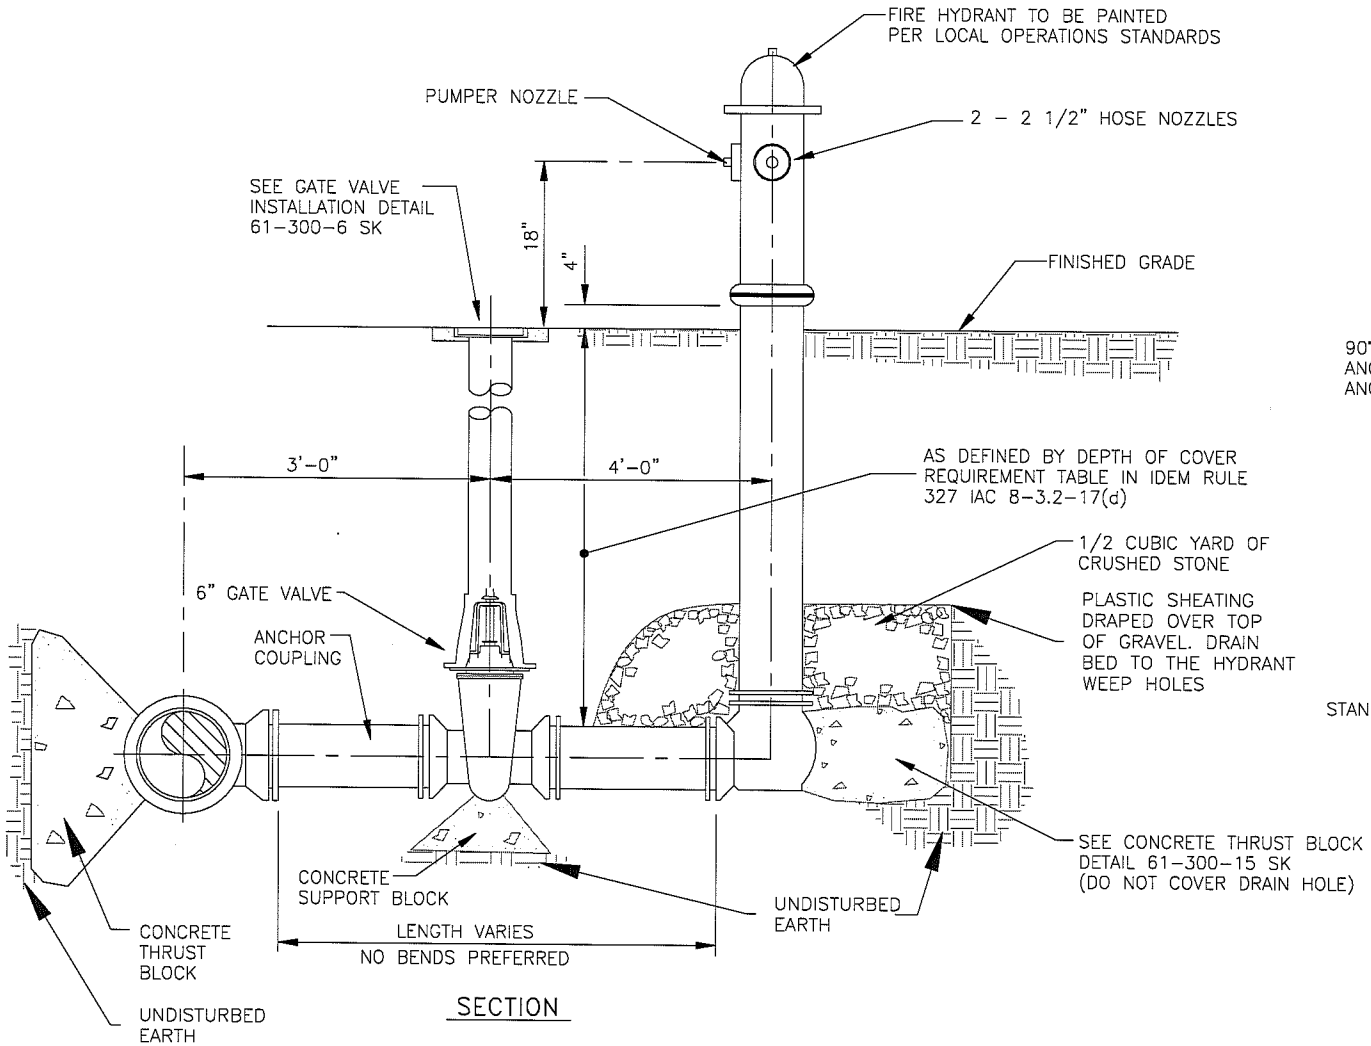

SECTION

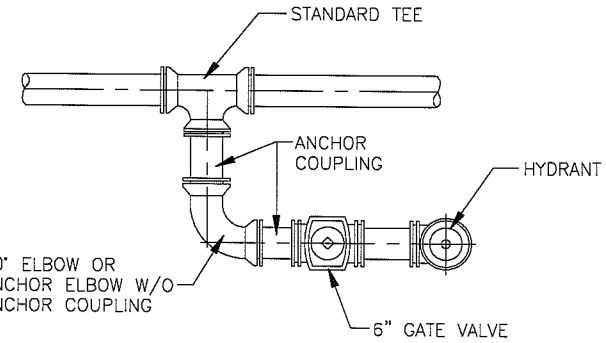

INSTALLATION PARALLEL TO MAIN

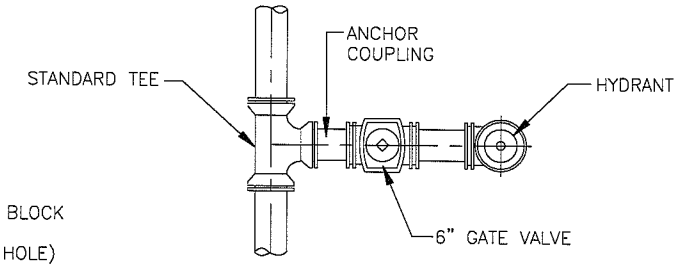

INSTALLATION PERPENDICULAR TO MAIN

NOTE:
THE NOTED THRUST RESTRAINT MECHANISMS ARE A MINIMUM RECOMMENDATION. LOCAL OPERATIONS SHALL OFFER PREFERENCES AND CONTRACTOR SHALL BE RESPONSIBLE FOR MEANS AND METHODS.